


VENT PIPE SHALL BE LOCATED OUT OF A TRAVEL WAY BACK OF A CURB OR SIDE-WALK, OR AS CALLED FOR ON THE PLANS. PIPE TO BE PAINTED WITH ONE COAT RED LEAD PRIMER PHENOLIC RESIN VARNISH BASE, INERTOL 621, AND FOLLOWED BY TWO (2) COATS OF EPOXY ESTER INERTOL PONKOTE ENAMEL. PRIMER SHALL BE ALLOWED TO DRY 72 HRS. IN GOOD WEATHER AND SHALL BE THOROUGHLY DRY BEFORE RECOATING. TOP COAT OF PAINT SHALL BE DARK GREEN.

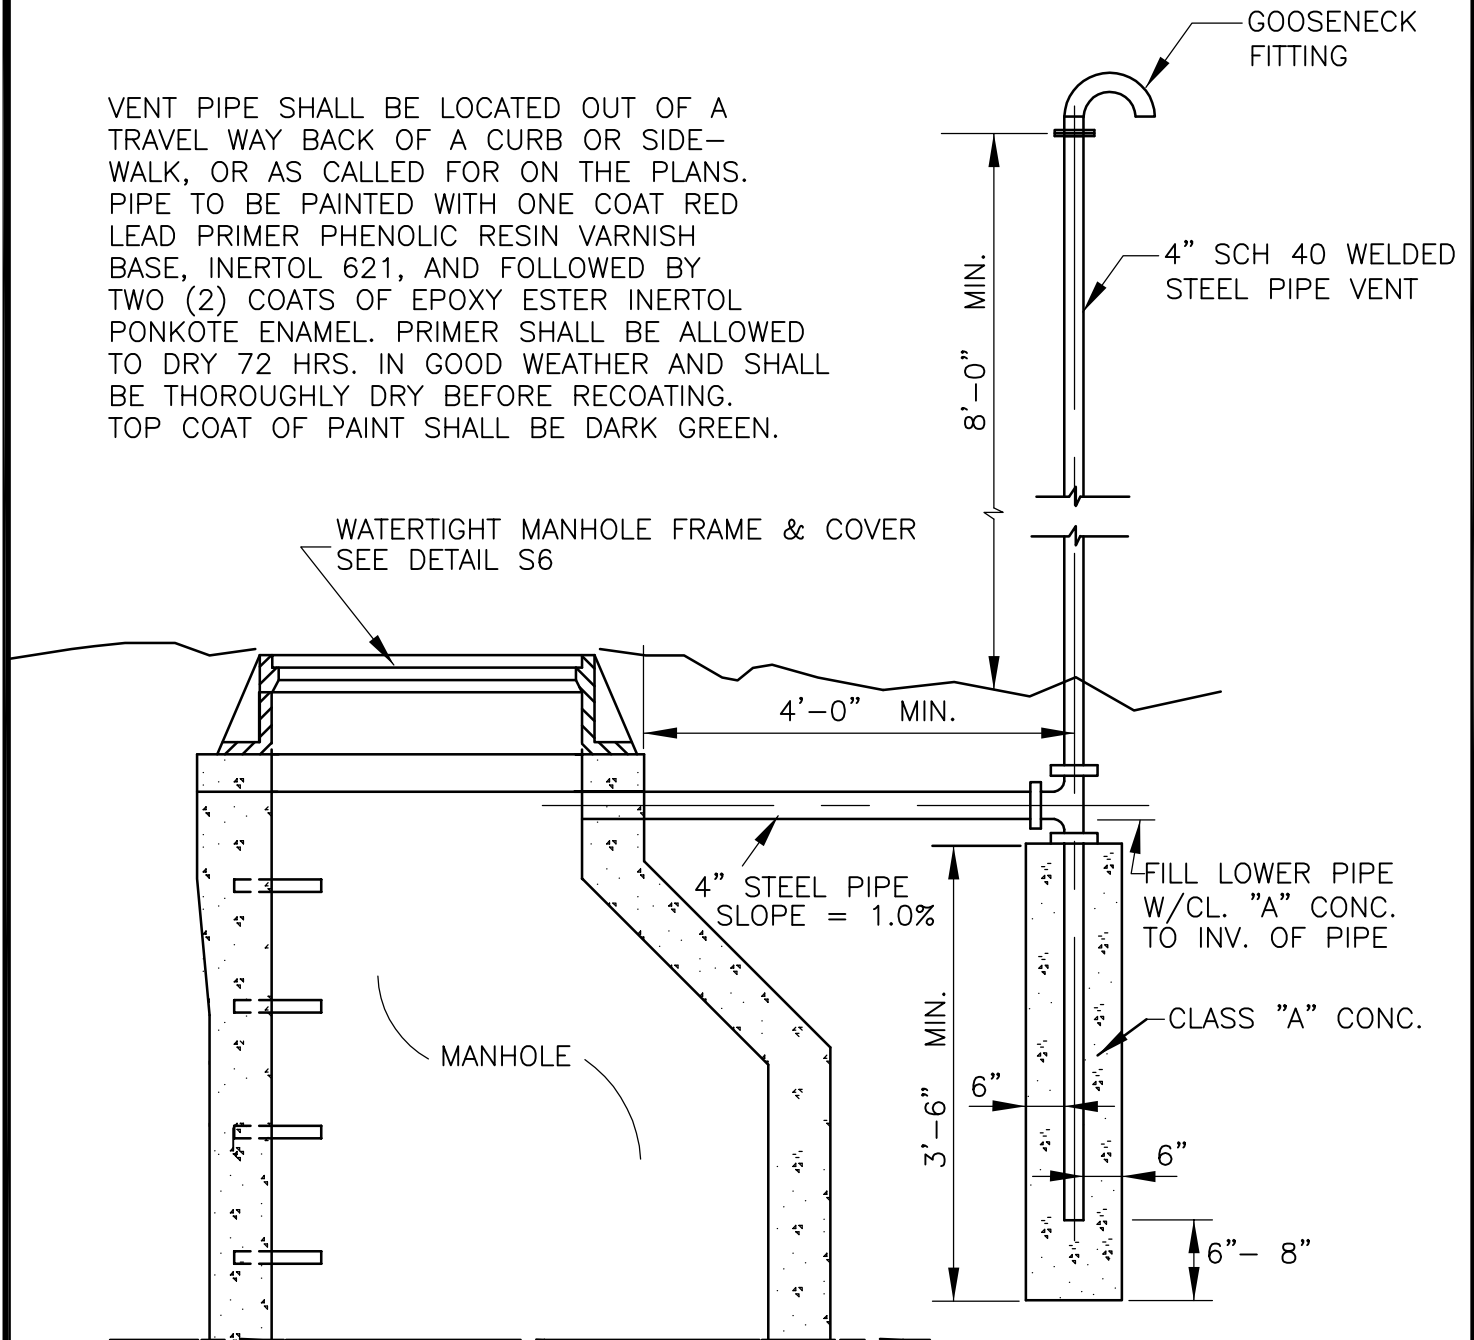

CITY OF BRENTWOOD
WATER SERVICES
STANDARD DETAIL

MANHOLE VENT DETAIL
APRIL, 2007

DRAWING NO. S8